DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act." No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

STRUCTURE	DESIGNED BEAMS (STRAIGHT STRANDS)																		OPTIONAL DESIGN					LOAD RATING FACTORS		
	PRESTRESSING STRANDS										DEBONDED STRAND PATTERN PER ROW								CONCRETE							
	SPAN LENGTH (ft)	BEAM NO.	BEAM TYPE	NON-STD STRAND PATTERN	TOTAL NO.	SIZE (in)	STRGTH fpu (ksi)	"e" ℄ (in)	"e" END (in)	TOT NO. DEB	DISTANCE FROM BOTTOM (in)	NO. OF STRANDS TOTAL	NO. OF STRANDS DE-BONDED	NUMBER OF STRANDS DEBONDED TO (ft from end) 3	6	9	12	15	RELEASE STRENGTH (1) f'ci (ksi)	MINIMUM 28 DAY COMP STRGTH f'c (ksi)	DESIGN LOAD COMP STRESS (TOP ℄) (SERVICE I) fct(ksi)	DESIGN LOAD TENSILE STRESS (BOTT ℄) (SERVICE III) fcb(ksi)	REQUIRED MINIMUM ULTIMATE MOMENT CAPACITY (STRENGTH I) (ft-kips)	LIVE LOAD DISTRIBUTION FACTOR (2) Moment	LIVE LOAD DISTRIBUTION FACTOR (2) Shear	STRENGTH I Inv	STRENGTH I Opr	SERVICE III Inv

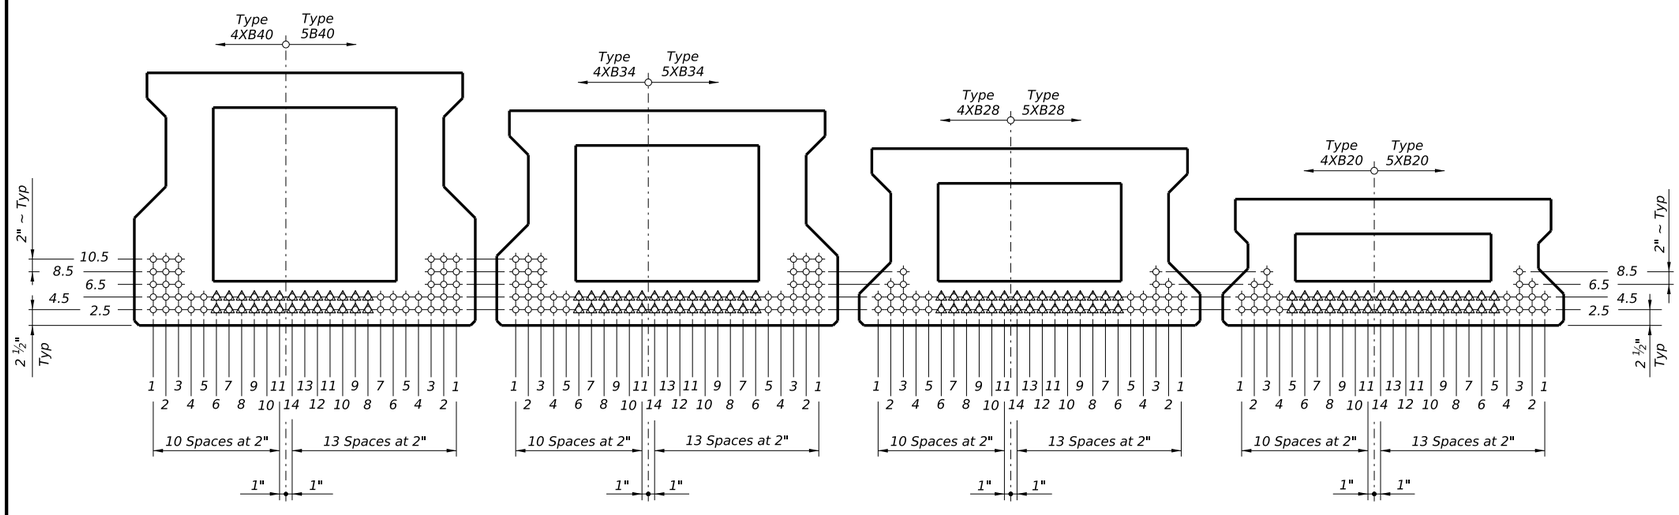

TxDOT XB40 BEAMS **TxDOT XB34 BEAMS** **TxDOT XB28 BEAMS** **TxDOT XB20 BEAMS**

(1) *Based on the following allowable stresses (ksi):*

Compression = 0.65 f'ci

Tension = 0.24 $\sqrt{f'ci}$

Optional designs must likewise conform.

(2) *Portion of full HL93.*

DESIGN NOTES:

Designed in accordance with AASHTO LRFD Bridge Design Specifications.

Load rated using Load and Resistance Factor Rating according to AASHTO Manual for Bridge Evaluation.

Prestress losses for the designed beams have been calculated for a relative humidity of ___ percent. Optional designs must likewise conform.

FABRICATION NOTES:

Provide Class H concrete.

Provide Grade 60 reinforcing steel bars.

Use low relaxation strands, each pretensioned to 75 percent of fpu.

When shown on this sheet, the Fabricator has the option of furnishing either the designed beam or an approved optional beam design. All optional design submittals and shop drawings must be signed, sealed and dated by a Professional Engineer registered in the State of Texas.

Locate strands for the designed beam as low as possible on the 2" grid system unless a non-standard strand pattern is indicated. Fill row "2.5", then row "4.5", then row "6.5", etc. Place strands within a row as follows:

1) Locate a strand in each "1" position.

2) Place strand symmetrically about vertical centerline of box.

3) Space strands as equally as possible across the entire width.

Strand debonding must comply with Item 424.4.2.2.2.4.

Do not debond strands in position "1." Distribute debonded strands equally about the vertical centerline. Decrease debonded lengths working inward, with debonding staggered in each row.

Full-length debonded strands are only permitted in positions marked △. Double wrap full-length debonded strands.

HL93 LOADING

Texas Department of Transportation

Bridge Division Standard

PRESTRESSED CONCRETE X-BEAM DESIGNS (NON-STANDARD SPANS)

XBND

FILE: XB-XBND-22.dgn	DN: JMH	CK: TAR	DW: JER	CK: TAR
©TxDOT August 2022	CONT	SECT	JOB	HIGHWAY
REVISIONS				
	DIST	COUNTY		SHEET NO.

DATE:
FILE: