


TABLE OF VARIABLE DIMENSIONS (5) AND QUANTITIES FOR ONE HEADWALL

Slope	Size of Pipe Arch		Values for One Pipe			Values To Be Added for Each Add'l Pipe			
	Design	Span	Rise	W	Reinf (Lbs) (1)	Conc (CY) (2)	W	Reinf (Lbs) (1)	Conc (CY) (2)
2:1	1	17"	13"	9' - 9"	130	1.1	2' - 5"	28	0.3
	2	21"	15"	10' - 9"	139	1.3	2' - 11"	33	0.3
	3	28"	20"	13' - 0"	184	1.8	3' - 9"	43	0.5
	4	35"	24"	14' - 11"	249	2.2	4' - 7"	50	0.6
	5	42"	29"	17' - 2"	311	3.2	5' - 5"	69	0.9
	6	49"	33"	19' - 1"	342	3.8	6' - 3"	77	1.1
	7	57"	38"	21' - 5"	438	4.7	7' - 2"	86	1.4
	8	64"	43"	23' - 8"	508	5.6	8' - 2"	110	1.6
	9	71"	47"	25' - 7"	577	6.5	9' - 1"	120	2.0
3:1	1	17"	13"	13' - 11"	182	1.6	2' - 5"	28	0.3
	2	21"	15"	15' - 3"	196	1.8	2' - 11"	33	0.3
	3	28"	20"	18' - 4"	270	2.6	3' - 9"	42	0.5
	4	35"	24"	20' - 11"	356	3.2	4' - 7"	50	0.6
	5	42"	29"	24' - 0"	434	4.5	5' - 5"	70	0.9
	6	49"	33"	26' - 7"	499	5.4	6' - 3"	77	1.1
	7	57"	38"	29' - 9"	628	6.7	7' - 2"	87	1.4
	8	64"	43"	32' - 10"	715	7.9	8' - 2"	111	1.6
	9	71"	47"	35' - 5"	798	9.2	9' - 1"	120	2.0
4:1	1	17"	13"	18' - 1"	236	2.1	2' - 5"	28	0.3
	2	21"	15"	19' - 9"	268	2.4	2' - 11"	33	0.3
	3	28"	20"	23' - 8"	336	3.3	3' - 9"	42	0.5
	4	35"	24"	26' - 11"	460	4.2	4' - 7"	50	0.6
	5	42"	29"	30' - 10"	557	5.8	5' - 5"	69	0.9
	6	49"	33"	34' - 1"	653	6.9	6' - 3"	78	1.1
	7	57"	38"	38' - 1"	819	8.6	7' - 2"	87	1.4
	8	64"	43"	42' - 0"	950	10.2	8' - 2"	111	1.7
	9	71"	47"	45' - 3"	1,053	11.9	9' - 1"	120	2.0
6:1	1	17"	13"	26' - 5"	343	3.1	2' - 5"	29	0.3
	2	21"	15"	28' - 9"	381	3.5	2' - 11"	33	0.3
	3	28"	20"	34' - 4"	504	4.9	3' - 9"	42	0.5
	4	35"	24"	38' - 11"	673	6.1	4' - 7"	50	0.6
	5	42"	29"	44' - 6"	823	8.5	5' - 5"	70	0.9
	6	49"	33"	49' - 1"	945	10.1	6' - 3"	78	1.1
	7	57"	38"	54' - 9"	1,227	12.5	7' - 2"	87	1.4
	8	64"	43"	60' - 4"	1,407	14.8	8' - 2"	110	1.7
	9	71"	47"	64' - 11"	1,571	17.3	9' - 1"	119	2.0


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: FILE:


- ① Total quantities include one 3'-1" lap for bars over 60 ft in length.
- ② Quantities shown are for metal pipe and will decrease slightly for concrete pipe installations.
- ③ For vehicle safety, construct curbs no more than 3" above finished grade. Reduce curb heights if necessary, to meet these requirements. No changes will be made in quantities and no additional compensation will be allowed for this work.
- ④ K is measure from top of curb to inside face of pipe.
- ⑤ Dimensions shown are usual and maximum.
- ⑥ Quantities shown are for one structure end only (one headwall).
- ⑦ Indicated slope is perpendicular to centerline pipe or pipes.

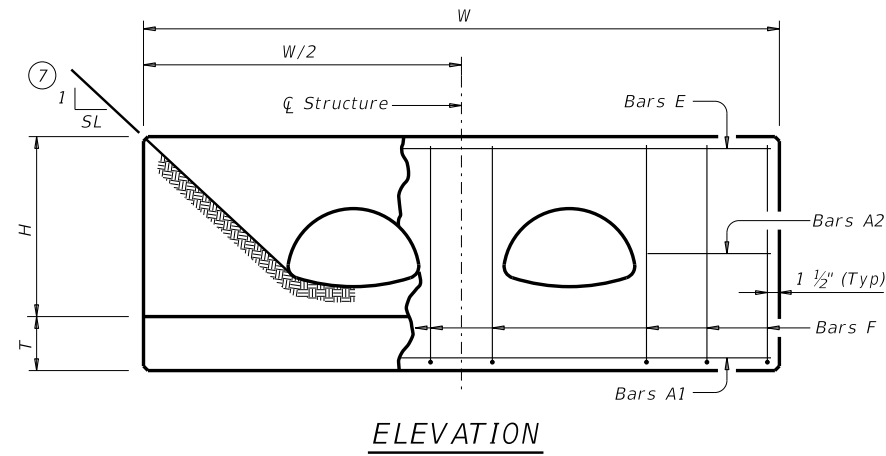

ELEVATION

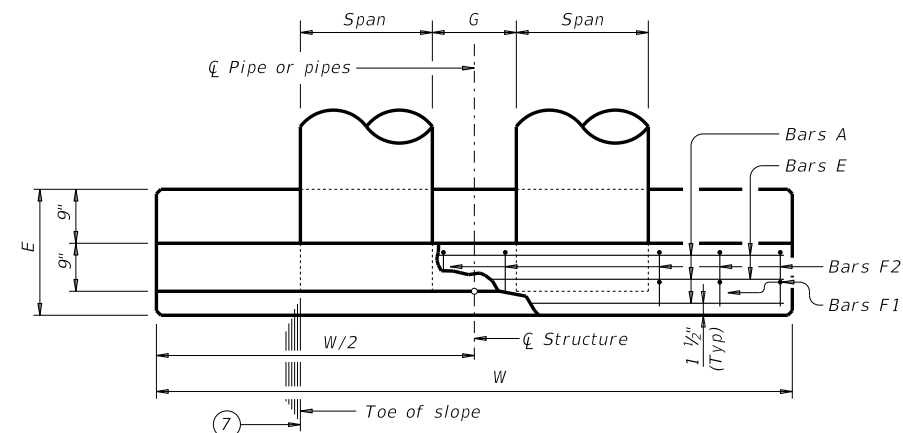

PLAN

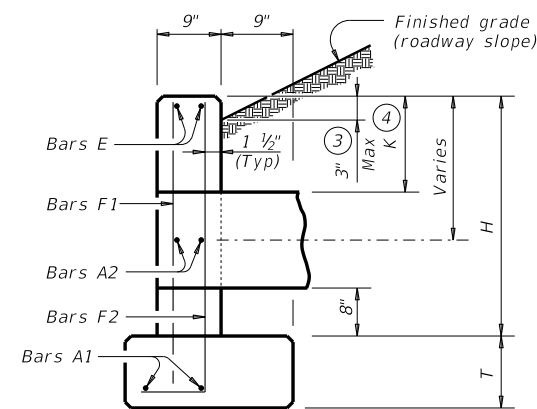


SECTION AT CENTER OF PIPE

TABLE OF CONSTANT DIMENSIONS

Design	Size of Pipe Arch		G	K (5)	H	T	E
	Span	Rise					
1	17"	13"	1' - 0"	1' - 0"	2' - 7"	0' - 10"	1' - 6"
2	21"	15"	1' - 2"	1' - 0"	2' - 9"	0' - 10"	1' - 6"
3	28"	20"	1' - 5"	1' - 0"	3' - 2"	0' - 10"	1' - 10"
4	35"	24"	1' - 8"	1' - 0"	3' - 6"	0' - 10"	2' - 0"
5	42"	29"	1' - 11"	1' - 0"	3' - 11"	1' - 0"	2' - 4"
6	49"	33"	2' - 2"	1' - 0"	4' - 3"	1' - 0"	2' - 6"
7	57"	38"	2' - 5"	1' - 0"	4' - 8"	1' - 0"	2' - 10"
8	64"	43"	2' - 10"	1' - 0"	5' - 1"	1' - 0"	3' - 0"
9	71"	47"	3' - 2"	1' - 0"	5' - 5"	1' - 0"	3' - 4"

TABLE OF (6) REINFORCING STEEL

Bar	Size	Spa	No.
A1	#5	~	2
A2	#5	1' - 6"	~
E	#5	~	2
F	#5	1' - 0"	~

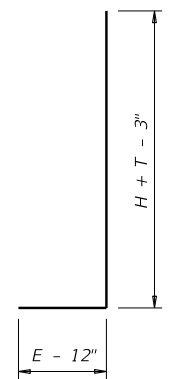

BARS F2

MATERIAL NOTES:
 Provide Grade 60 reinforcing steel.
 Provide Class C concrete (f'c = 3,600 psi).

GENERAL NOTES:
 Designed according to AASHTO LRFD Bridge Design Specifications.
 Do not mount bridge rails of any type directly to these culvert headwalls.
 This standard may not be used for wall heights, H, exceeding the values shown.

Cover dimensions are clear dimensions, unless noted otherwise. Reinforcing dimensions are out-to-out of bars.

Bridge Division Standard

CONCRETE HEADWALLS WITH PARALLEL WINGS FOR NON-SKEWED ARCH PIPE CULVERTS

CH-PW-A-0

FILE: chpa0ste-20.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT February 2020	CONT	SECT	JOB	HIGHWAY
REVISIONS				
DIST	COUNTY			SHEET NO.