



DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: FILE:

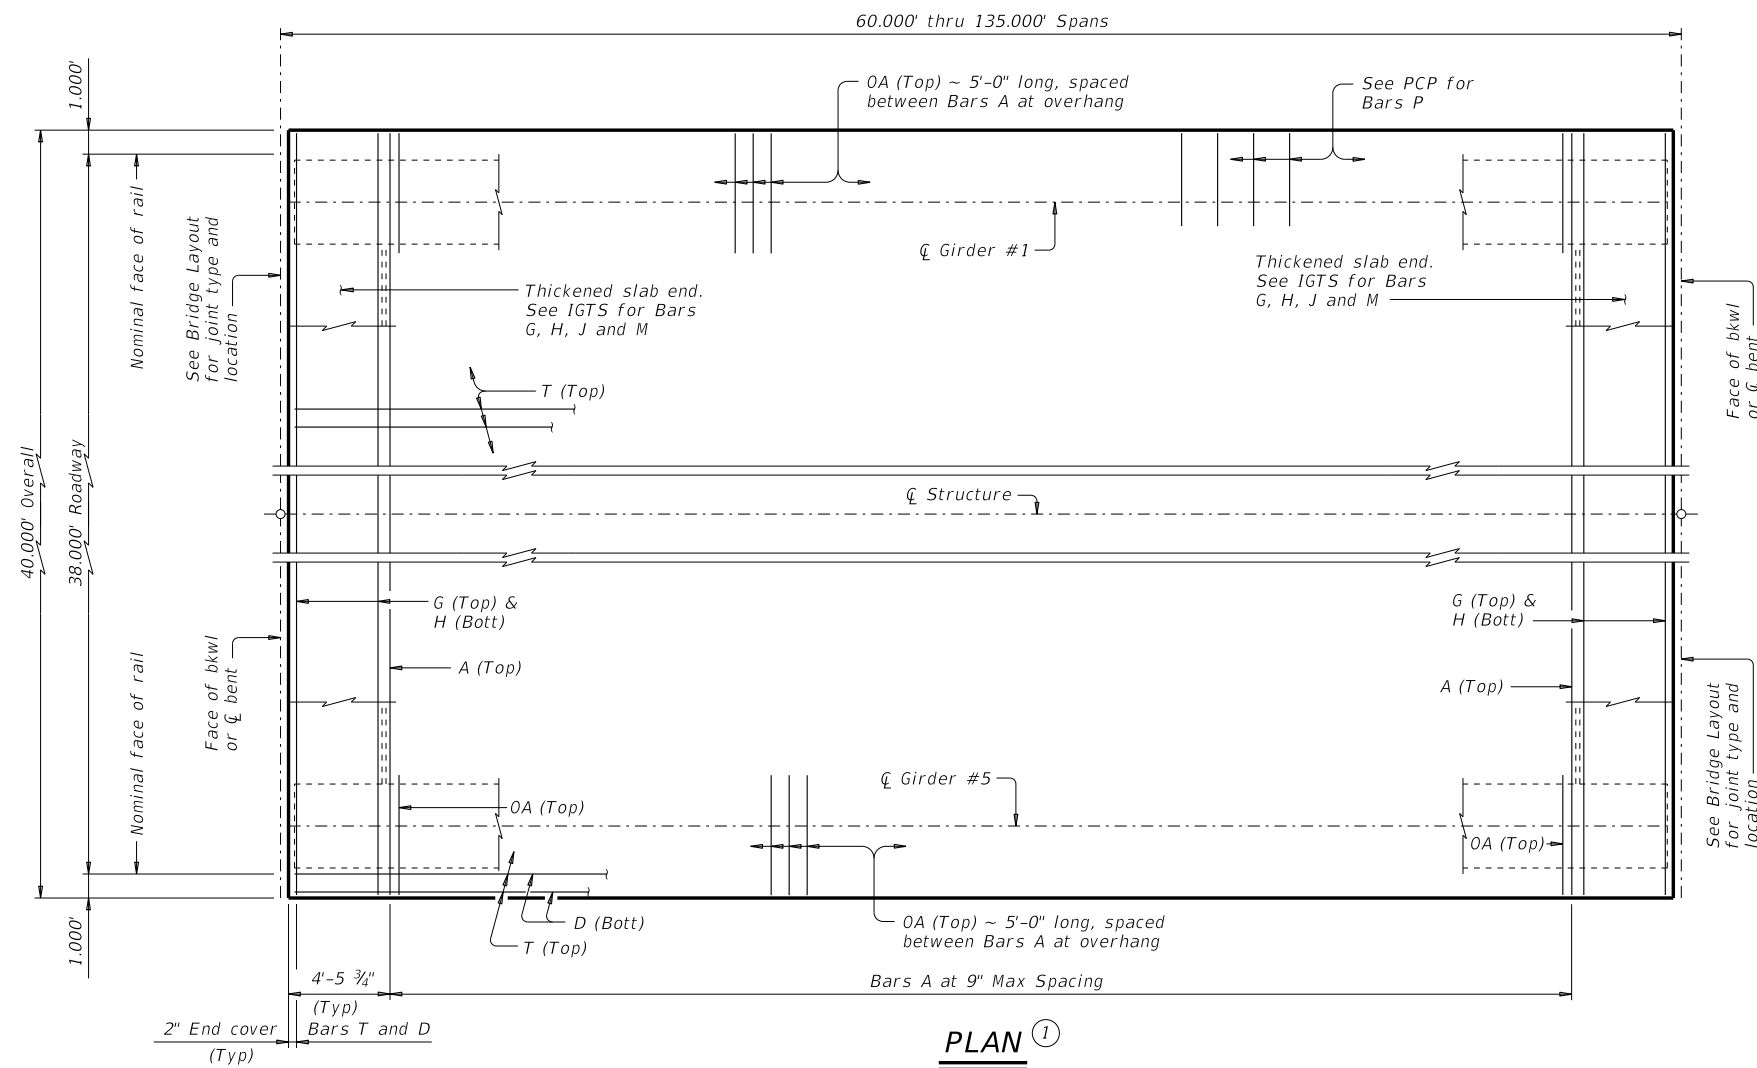

BAR TABLE	
BAR	SIZE
A	#4
D	#4
G	#4
H	#4
J	#4
M	#4
OA	#5
P	#4
T	#4

- ① If multi-span units (with slab continuous over interior bents) are indicated on the Bridge Layout, see standard IGCS for adjustment to slab reinforcement and quantities.
- ② "y" value shown is based on theoretical girder camber, dead load deflection from an 8 1/2" concrete slab, a constant roadway grade, and using precast panels (PCP). The Contractor will adjust this value as necessary for any roadway vertical curve and/or if the precast overhang panel (PCP(0)) option is used.

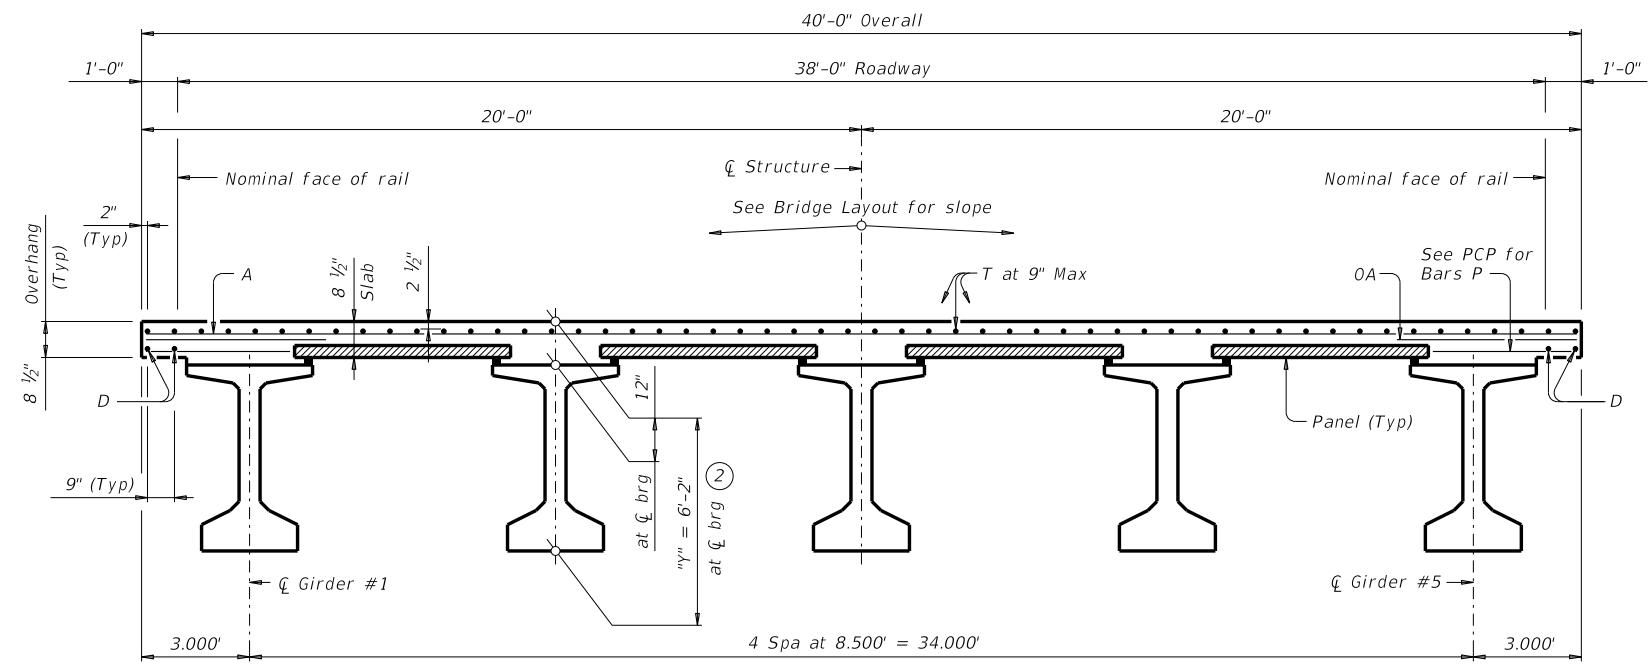

HL93 LOADING SHEET 1 OF 2

Texas Department of Transportation Bridge Division Standard

PRESTRESSED CONCRETE I-GIRDER SPANS (TYPE Tx62) 38' ROADWAY


SIG-62-38

FILE: sig33sts-19.dgn	DN: JMH	CK: GC	DW: JTR	CK: TAR
©TxDOT August 2017	CONT	SECT	JOB	HIGHWAY
REVISIONS				
10-19: Increased "X" and "Y" Values				
DIST	COUNTY			SHEET NO.

DISCLAIMER:
 The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE:
 FILE:

TABLE OF DEAD LOAD DEFLECTIONS		
TYPE Tx62 GIRDERS		
SPAN LENGTH	"A"	"B"
Ft	Ft	Ft
60	0.006	0.008
65	0.009	0.012
70	0.011	0.016
75	0.015	0.021
80	0.019	0.027
85	0.025	0.035
90	0.031	0.044
95	0.039	0.055
100	0.048	0.067
105	0.058	0.082
110	0.071	0.100
115	0.085	0.119
120	0.101	0.142
125	0.119	0.167
130	0.140	0.196
135	0.163	0.229

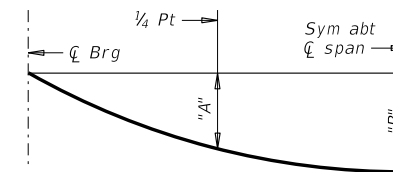

DEAD LOAD DEFLECTION DIAGRAM

Calculated deflections shown are due to the concrete slab on interior girders only ($E_c = 5000$ ksi). Adjust values as required for exterior girders and if optional slab forming is used. These values may require field verification.

TABLE OF ESTIMATED QUANTITIES					
SPAN LENGTH	REINF CONCRETE SLAB	Prestressed Concrete Girders			TOTAL REINF STEEL ^④
		ABUT TO INT BT ^③	INT BT TO INT BT ^③	ABUT TO ABUT ^③	
Ft	SF	LF	LF	LF	Lb
60	2,400	297.50	297.50	297.50	5,520
65	2,600	322.50	322.50	322.50	5,980
70	2,800	347.50	347.50	347.50	6,440
75	3,000	372.50	372.50	372.50	6,900
80	3,200	397.50	397.50	397.50	7,360
85	3,400	422.50	422.50	422.50	7,820
90	3,600	447.50	447.50	447.50	8,280
95	3,800	472.50	472.50	472.50	8,740
100	4,000	497.50	497.50	497.50	9,200
105	4,200	522.50	522.50	522.50	9,660
110	4,400	547.50	547.50	547.50	10,120
115	4,600	572.50	572.50	572.50	10,580
120	4,800	597.50	597.50	597.50	11,040
125	5,000	622.50	622.50	622.50	11,500
130	5,200	647.50	647.50	647.50	11,960
135	5,400	672.50	672.50	672.50	12,420

- ③ Fabricator will adjust lengths for girder slopes as required.
- ④ Reinforcing steel weight is calculated using an approximate factor of 2.3 lbs/SF.

GENERAL NOTES:

Designed according to AASHTO LRFD Bridge Design Specifications.
 Multi-span units, with slab continuous over interior bents, may be formed with the details shown on this sheet and standard IGCS.
 See IGTS standard for Thickened Slab End details and quantity adjustments.
 See PCP and PCP-FAB for panel details not shown.
 See PCP(0) and PCP(0)-FAB for precast overhang panel details if this option is used.
 See IGMS standard for miscellaneous details.
 See applicable rail details for rail anchorage in slab.
 See PMDF standard for details and quantity adjustments if this option is used.
 This standard does not support the use of transition bents.

Cover dimensions are clear dimensions, unless noted otherwise.

MATERIAL NOTES:

Provide Class S concrete ($f'_c = 4,000$ psi).
 Provide Class S (HPC) concrete if shown elsewhere in the plans.
 Provide Grade 60 reinforcing steel.
 Provide bar laps, where required, as follows:
 Uncoated ~ #4 = 1'-7"
 Epoxy coated ~ #4 = 2'-5"
 Deformed Welded Wire Reinforcement (WWR) (ASTM A1064) of equal size and spacing may be substituted for Bars A, D, OA, P or T unless noted otherwise.

HL93 LOADING

SHEET 2 OF 2

Texas Department of Transportation				Bridge Division Standard	
<p>PRESTRESSED CONCRETE I-GIRDER SPANS (TYPE Tx62) 38' ROADWAY</p> <p style="font-size: 1.2em; font-weight: bold;">SIG-62-38</p>					
FILE: sig33sts-19.dgn	DN: JMH	CK: GC	DW: JTR	CK: TAR	
©TxDOT August 2017		CONT	SECT	JOB	HIGHWAY
REVISIONS					
10-19: Increased "X" and "Y" Values					
DIST			COUNTY		SHEET NO.