



DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: FILE:

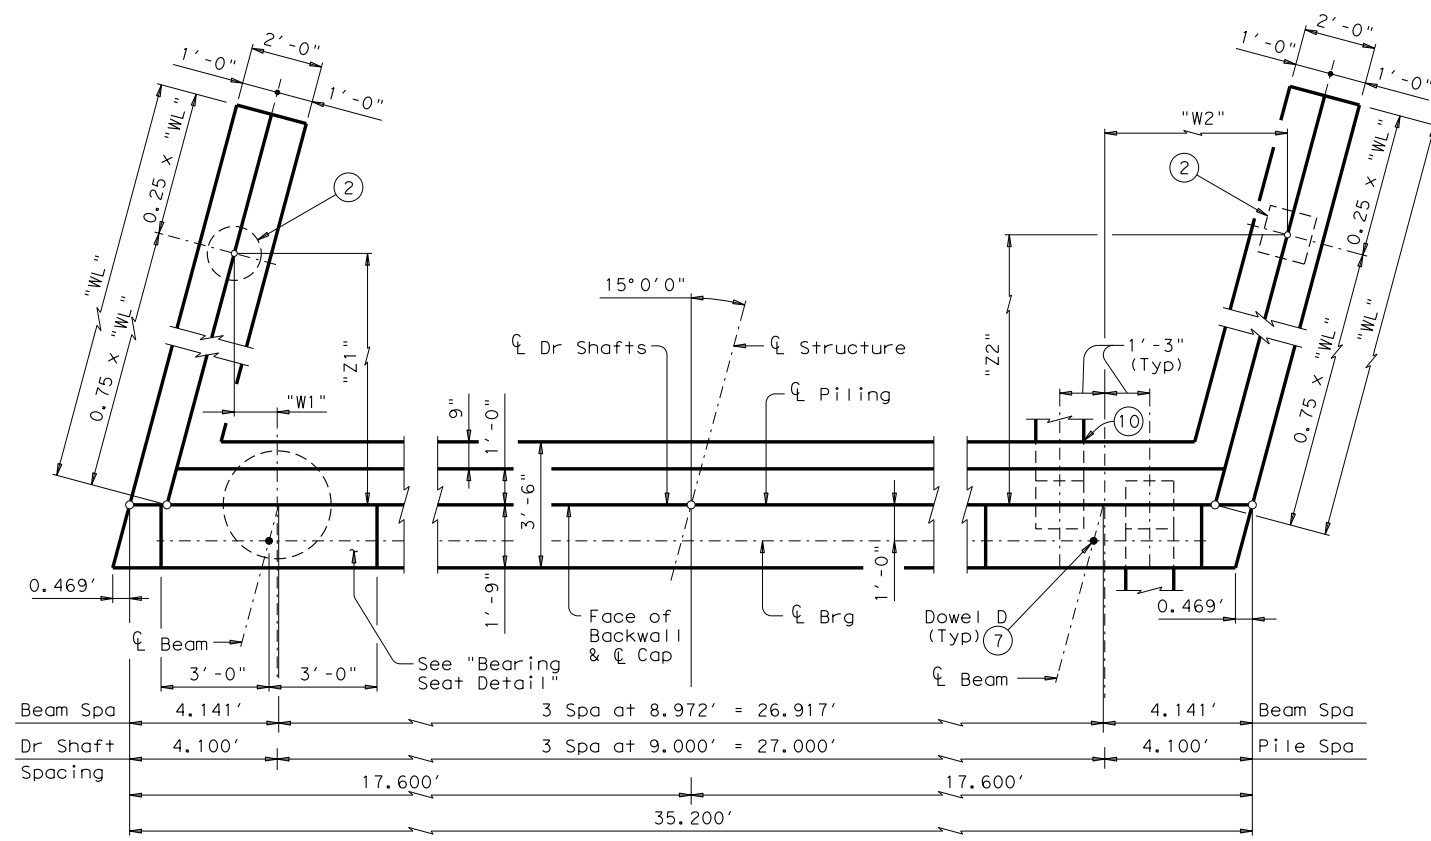


SHOWING DRILLED SHAFTS **PLAN 1** SHOWING PILES

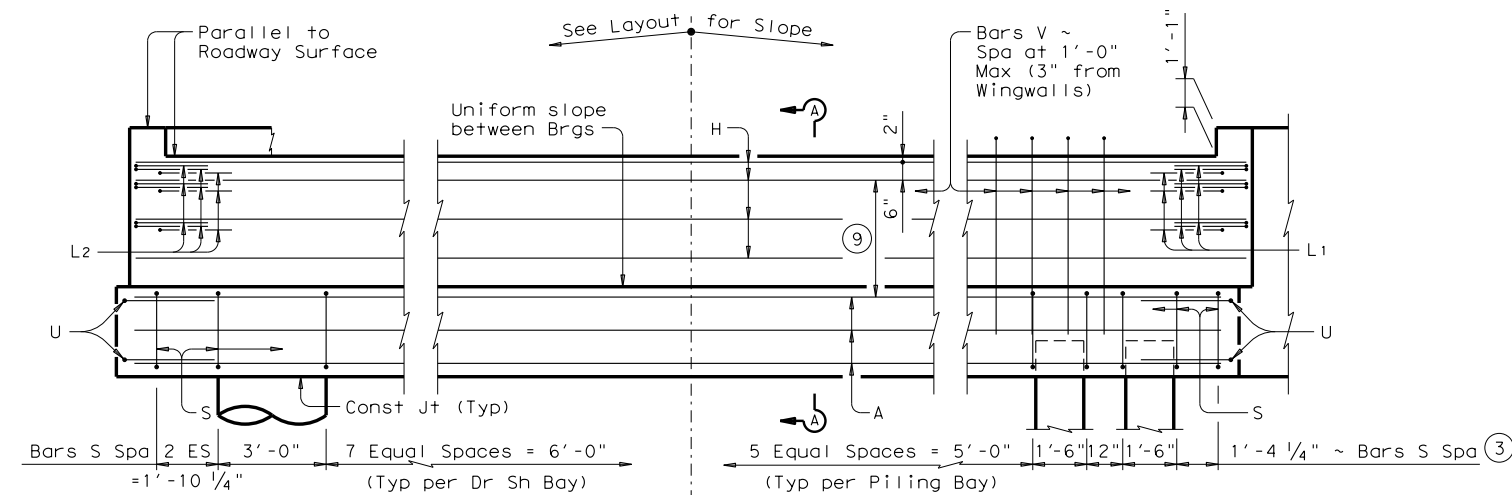


SHOWING DRILLED SHAFTS **ELEVATION** SHOWING PILES

Header Slope	Beam Type	Wingwall Type	Wingwall Lgth "WL"	"W1"	"Z1"	"W2"	"Z2"				
2:1	XB20	Cantilevered	7.000'	Not Applicable							
	XB28	Cantilevered	8.000'								
	XB34	Cantilevered	9.000'								
	XB40	Cantilevered	10.000'								
3:1	XB20	Cantilevered	10.000'	Not Applicable							
	XB28	Cantilevered	12.000'								
	XB34	Founded	14.000'					0.347'	10.142'	5.782'	10.142'
	XB40	Founded	15.000'					0.153'	10.867'	5.976'	10.867'

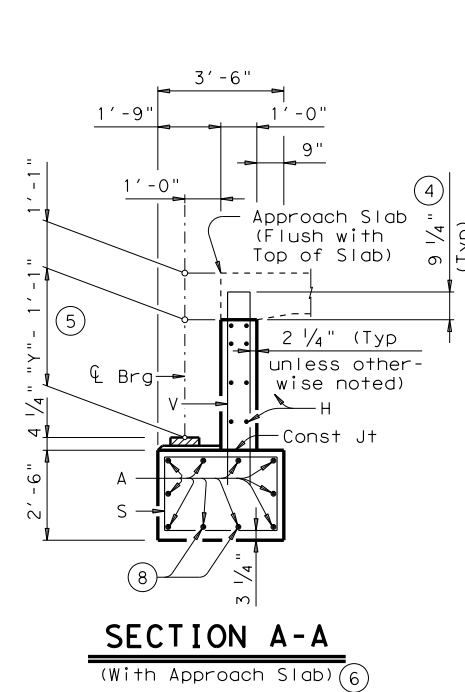


**SECTION A-A**  
(With Approach Slab) 6

Level along a line perpendicular to backwall. Uniform slope between Left and Right Bearing Seat Elevations with wood float finish.

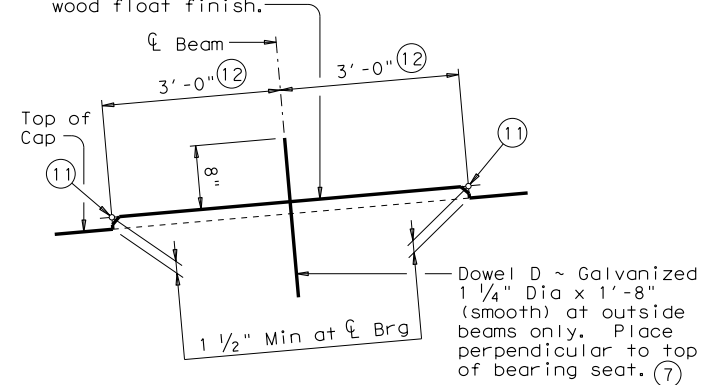

**BEARING SEAT DETAIL**

(Bearing surface must be clean and free of all loose material before placing bearing pad.)

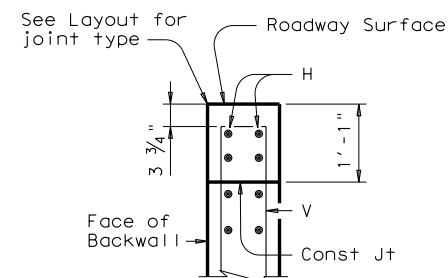

**BACKWALL DETAIL**

(Without Approach Slab) 6

- See Table A for variable dimensions based on header slope and beam type.
- See Table A to determine if wingwall foundations are required.
- For Piling larger than 16" adjust Bars S spacing as required to avoid Piling.
- Increase as required to maintain 3 3/4" from Finished Grade.
- See Span details for "Y" value.
- See Bridge Layout to determine if Approach Slab is present.
- Omit Dowels D at end of unit. Deduct 14 lbs from reinforcing steel total.
- With pile foundations, move Bars A shown to clear piles.
- Spacing based on beam type:  
XB20 ~ 2 Equal Spaces  
XB28 ~ 3 Equal Spaces  
XB34 ~ 3 Equal Spaces  
XB40 ~ 3 Equal Spaces
- See Detail A on FD standard.
- Right and left elevations and locations are provided elsewhere.
- Measured along  $\ell$  of Bearing.

**TABLE OF FOUNDATION LOADS**

Span Length	Beam Types 5XB20 Thru 5XB40	
	Tons/Shaft	Tons/Pile
40	56	42
45	59	44
50	63	46
55	67	48
60	71	50
65	74	52
70	78	54
75	82	56
80	85	58
85	89	59
90	92	61
95	96	63
100	99	65
105	103	67

**GENERAL NOTES:**


Designed according to AASHTO LRFD Specifications.  
Concrete strength  $f'_c = 3,600$  psi.  
All cap and wall reinforcement must be Grade 60.  
Galvanize dowel bars D.  
See Bridge Layout for header slope and foundation type, size and length.  
See Foundation Detail Standard Sheet, FD, for all foundation details and notes.  
See Concrete Riprap Standard Sheet, CRR, for riprap attachment details, if applicable.  
See applicable rail details for rail anchorage in wingwalls.  
Details are drawn showing right forward skew. See Bridge Layout for actual skew direction.  
These abutment details may be used with Standard SXB-32-15 only.

HL93 LOADING


SHEET 1 OF 2

		<b>Bridge Division Standard</b>	
<b>ABUTMENTS</b> <b>TYPE 5XB20 THRU 5XB40</b> <b>PRESTR CONC X-BEAMS</b> <b>32' ROADWAY 15° SKEW</b> <b>AXB-32-15</b>			
FILE: xbstde42.dgn	DN: JMH	CK: AM	DW: JTR
DATE: June 2011	CONT	SECT	JOB
REVISIONS			HIGHWAY
	DIST	COUNTY	SHEET NO.

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

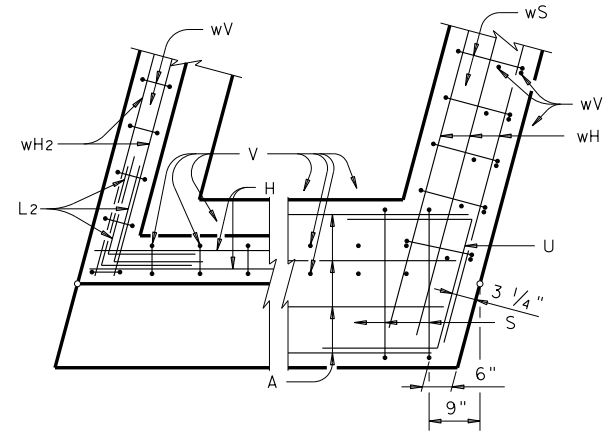


BACKWALL CAP  
CORNER DETAILS

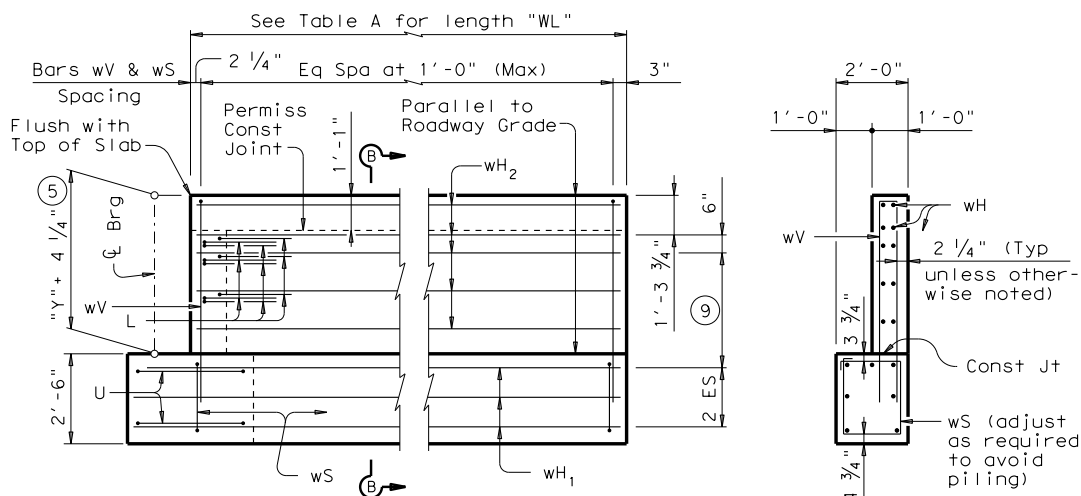

WINGWALL ELEVATION

SECTION B-B

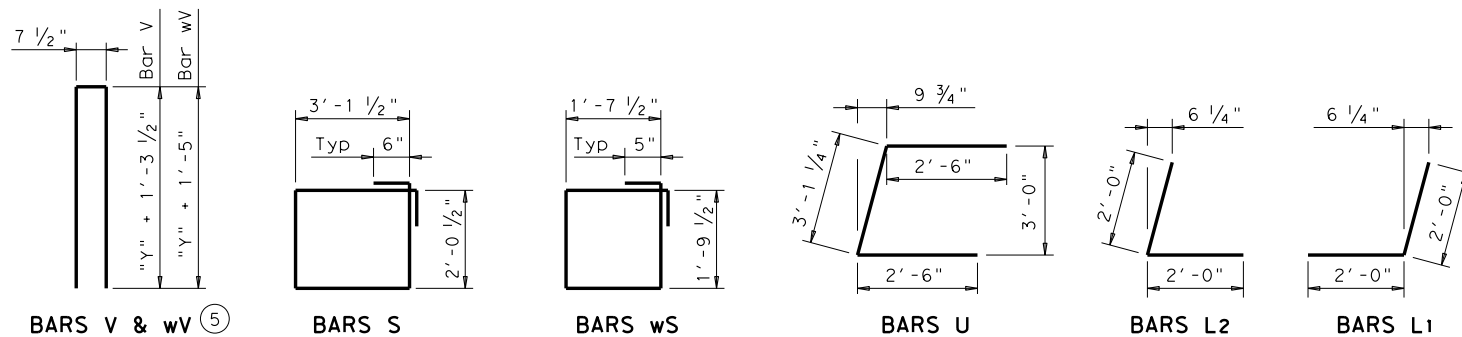

BARS V & wV

BARS S

BARS wS

BARS U

BARS L2

BARS L1

TABLES OF ESTIMATED QUANTITIES WITH 2:1 HEADER SLOPE <sup>13</sup>

TYPE 5XB20 BEAMS					TYPE 5XB28 BEAMS					TYPE 5XB34 BEAMS					TYPE 5XB40 BEAMS								
Bar	No.	Size	Length	Weight	Bar	No.	Size	Length	Weight	Bar	No.	Size	Length	Weight	Bar	No.	Size	Length	Weight				
A	10	#11	34'-3"	1,820	A	10	#11	34'-3"	1,820	A	10	#11	34'-3"	1,820	A	10	#11	34'-3"	1,820				
D (7)	2	1 1/4"D	1'-8"	14	D (7)	2	1 1/4"D	1'-8"	14	D (7)	2	1 1/4"D	1'-8"	14	D (7)	2	1 1/4"D	1'-8"	14				
H	6	#6	34'-10"	314	H	8	#6	34'-10"	419	H	8	#6	34'-10"	419	H	8	#6	34'-10"	419				
L1	9	#6	4'-0"	54	L1	9	#6	4'-0"	54	L1	9	#6	4'-0"	54	L1	9	#6	4'-0"	54				
L2	9	#6	4'-0"	54	L2	9	#6	4'-0"	54	L2	9	#6	4'-0"	54	L2	9	#6	4'-0"	54				
S	30	#5	11'-4"	355	S	30	#5	11'-4"	355	S	30	#5	11'-4"	355	S	30	#5	11'-4"	355				
U	4	#6	8'-1"	49	U	4	#6	8'-1"	49	U	4	#6	8'-1"	49	U	4	#6	8'-1"	49				
V	34	#5	8'-5"	299	V	34	#5	9'-9"	346	V	34	#5	10'-9"	381	V	34	#5	11'-9"	417				
wH1	14	#6	8'-5"	177	wH1	14	#6	9'-5"	198	wH1	14	#6	10'-5"	219	wH1	14	#6	11'-5"	240				
wH2	16	#6	6'-8"	160	wH2	20	#6	7'-8"	230	wH2	20	#6	8'-8"	260	wH2	20	#6	9'-8"	290				
wS	16	#4	7'-8"	82	wS	18	#4	7'-8"	92	wS	20	#4	7'-8"	102	wS	22	#4	7'-8"	113				
wV	16	#5	8'-8"	145	wV	18	#5	10'-0"	188	wV	20	#5	11'-0"	229	wV	22	#5	12'-0"	275				
Reinforcing Steel				Lb	3,523	Reinforcing Steel				Lb	3,819	Reinforcing Steel				Lb	3,956	Reinforcing Steel				Lb	4,100
Class "C" Concrete				CY	17.3	Class "C" Concrete				CY	19.1	Class "C" Concrete				CY	20.7	Class "C" Concrete				CY	22.3

TABLES OF ESTIMATED QUANTITIES WITH 3:1 HEADER SLOPE <sup>13</sup>

TYPE 5XB20 BEAMS					TYPE 5XB28 BEAMS					TYPE 5XB34 BEAMS					TYPE 5XB40 BEAMS								
Bar	No.	Size	Length	Weight	Bar	No.	Size	Length	Weight	Bar	No.	Size	Length	Weight	Bar	No.	Size	Length	Weight				
A	10	#11	34'-3"	1,820	A	10	#11	34'-3"	1,820	A	10	#11	34'-3"	1,820	A	10	#11	34'-3"	1,820				
D (7)	2	1 1/4"D	1'-8"	14	D (7)	2	1 1/4"D	1'-8"	14	D (7)	2	1 1/4"D	1'-8"	14	D (7)	2	1 1/4"D	1'-8"	14				
H	6	#6	34'-10"	314	H	8	#6	34'-10"	419	H	8	#6	34'-10"	419	H	8	#6	34'-10"	419				
L1	9	#6	4'-0"	54	L1	9	#6	4'-0"	54	L1	9	#6	4'-0"	54	L1	9	#6	4'-0"	54				
L2	9	#6	4'-0"	54	L2	9	#6	4'-0"	54	L2	9	#6	4'-0"	54	L2	9	#6	4'-0"	54				
S	30	#5	11'-4"	355	S	30	#5	11'-4"	355	S	30	#5	11'-4"	355	S	30	#5	11'-4"	355				
U	4	#6	8'-1"	49	U	4	#6	8'-1"	49	U	4	#6	8'-1"	49	U	4	#6	8'-1"	49				
V	34	#5	8'-5"	298	V	34	#5	9'-9"	346	V	34	#5	10'-9"	381	V	34	#5	11'-9"	417				
wH1	14	#6	11'-5"	240	wH1	14	#6	13'-5"	282	wH1	14	#6	15'-5"	324	wH1	14	#6	16'-5"	345				
wH2	16	#6	9'-8"	232	wH2	20	#6	11'-8"	350	wH2	20	#6	13'-8"	411	wH2	20	#6	14'-8"	441				
wS	22	#4	7'-8"	113	wS	26	#4	7'-8"	133	wS	30	#4	7'-8"	154	wS	32	#4	7'-8"	164				
wV	22	#5	8'-8"	199	wV	26	#5	10'-0"	271	wV	30	#5	11'-0"	344	wV	32	#5	12'-0"	401				
Reinforcing Steel				Lb	3,742	Reinforcing Steel				Lb	4,147	Reinforcing Steel				Lb	4,379	Reinforcing Steel				Lb	4,533
Class "C" Concrete				CY	19.1	Class "C" Concrete				CY	21.7	Class "C" Concrete				CY	24.1	Class "C" Concrete				CY	25.9

- (5) See Span details for "Y" value.
- (7) Omit Dowels D at end of unit. Deduct 14 lbs from reinforcing steel total.
- (9) Spacing based on beam type:  
 XB20 ~ 2 Equal Spaces  
 XB28 ~ 3 Equal Spaces  
 XB34 ~ 3 Equal Spaces  
 XB40 ~ 3 Equal Spaces
- (13) Quantities shown are for one Abutment only (with Approach Slab). With no Approach Slab, add 1.3 CY Class "C" Concrete and 209 Lbs Reinforcing Steel for 4 additional H bars.

**Texas Department of Transportation** Bridge Division Standard

**ABUTMENTS**  
 TYPE 5XB20 THRU 5XB40  
 PRESTR CONC X-BEAMS  
 32' ROADWAY 15° SKEW  
 AXB-32-15

FILE: xbstde42.dgn	DN: JMH	CK: AM	DW: JTR	CK: JMH
©TxDOT June 2011	CONT	SECT	JOB	HIGHWAY
REVISIONS	DIST	COUNTY	SHEET NO.	

DATE: FILE: