



DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE:
FILE:

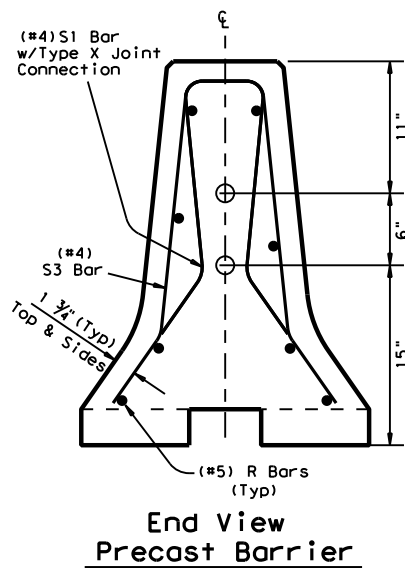


**End View
Precast Barrier**

See sheet 2 of 3 for
Joint connection Type X

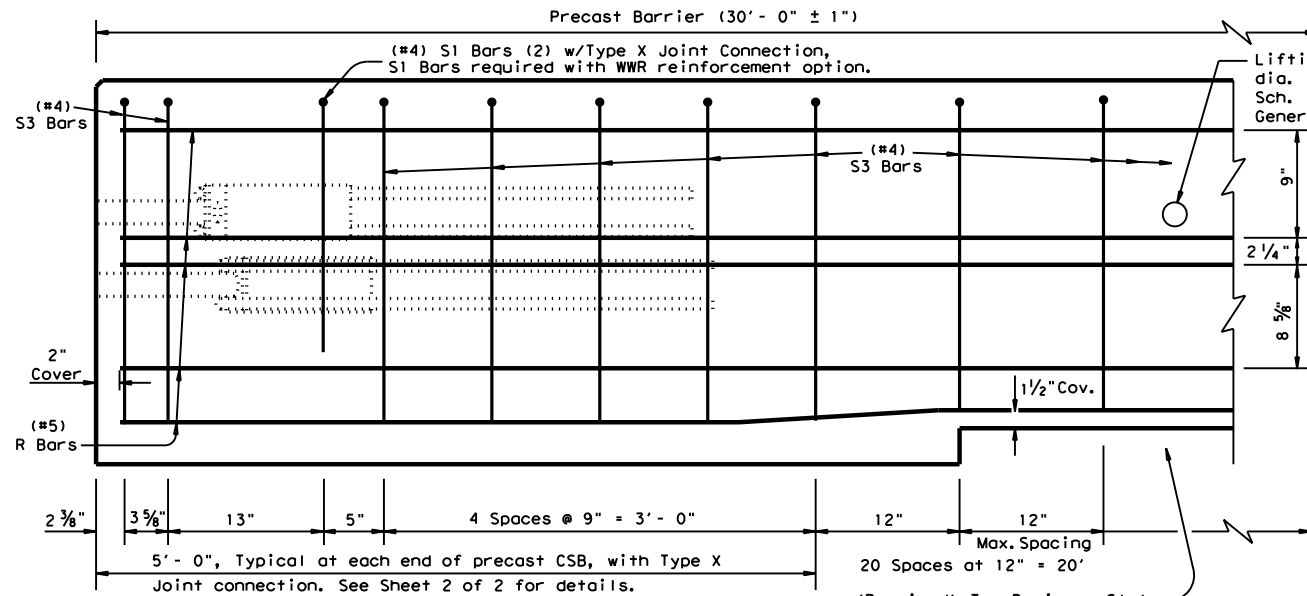


**Reinforcement for Precast (CSB)
Concrete Safety Barrier (Type 1)**

Showing reinforcement for Joint Type X

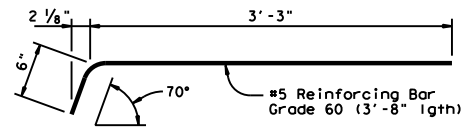


DEFORMED BAR ANCHOR DETAILS

Two (2) Bars required per assembly.
Eight (8) required per joint.

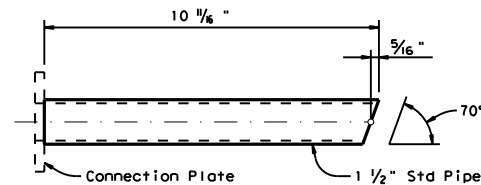


UPPER CONNECTION PIPE DETAILS

One (1) Steel Pipe required per Upper Assembly.
Two (2) required per joint.

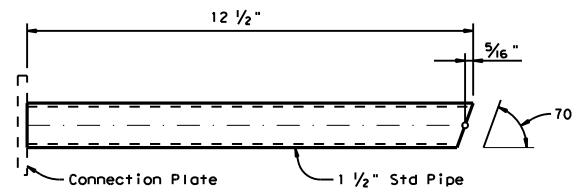

LOWER CONNECTION PIPE DETAILS

One (1) Steel Pipe required per Lower Assembly.
Two (2) required per joint.

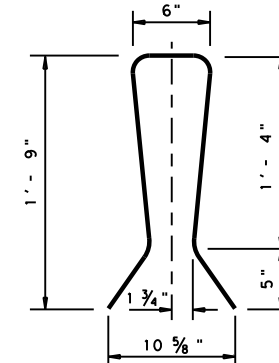


S1 Bar

#4 Bar (2)
(Joint Type X)

S3 Bar

#4 Bar

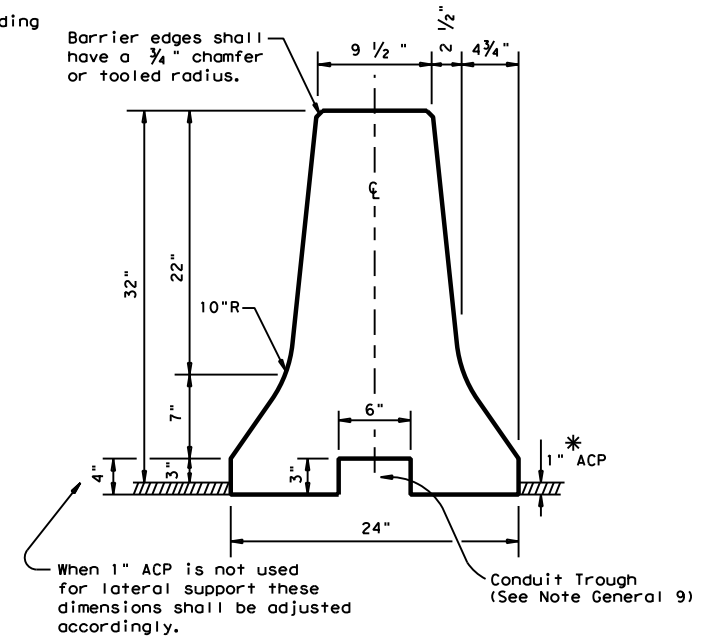


Concrete Safety Barrier

* When 1" ACP is "not" used as lateral support for permanent barrier placement. A permissible method of attaining the equivalent lateral support may be used, See CSB(6) sheet.

GENERAL NOTES

- Concrete shall be Class H with a minimum compressive strength of 3,600 psi.
- Where used, rebar reinforcement shall be Grade 60 and conform to ASTM A615.
- Precast barrier length shall be 30 ft. unless otherwise specified on the plans.
- All precast barrier edges shall have a 3/4 inch chamfer or tooled radius.
- All concrete, reinforcement, joint connection systems, grout etc. as shown, are considered as part of the barrier payment.
- All steel assemblies for joint shall be galvanized after fabrication in accordance with Item 445, "Galvanizing."
- Regardless of the method of handling, barrier lifting points shall be approx. 7.5 feet from the ends of the barrier. Lifting devices and attachments to barrier sections shall be approved by the Engineer.
- Surface finishing and grouting (where required) shall be two parts sand one part cement with enough water to make the mixture plastic. Grouting shall be done in a manner that will assure a smooth surface. Surface finishing shall be considered subsidiary to the various bid items involved.
- Conduit trough when required shall be shown elsewhere on the plans, or as directed by the Engineer.

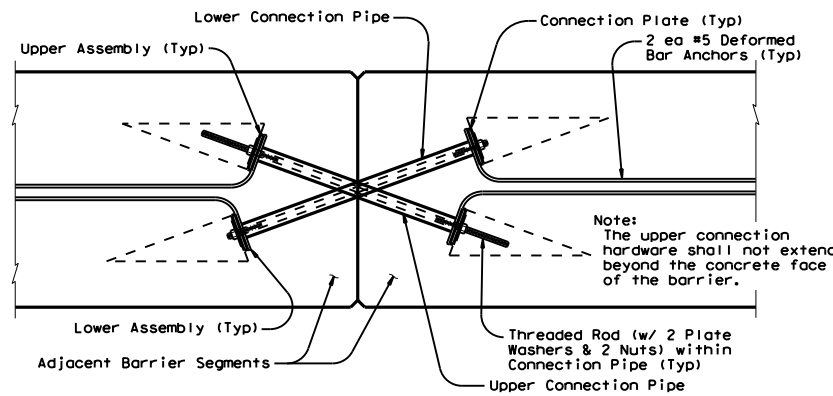

TYPE X JOINT INSTALLATION DETAIL

Barrier reinforcing and Type X Joint Leave-Out dimensions not shown for clarity.


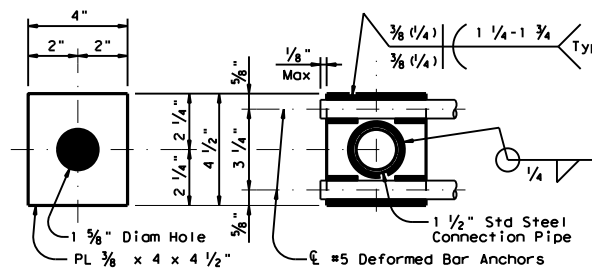


PLATE DIMENSIONS


WELDING DETAILS

CONNECTION PLATE DETAILS

One (1) Plate required per assembly.
Four (4) required per joint. All steel fittings for joint Type X shall be galvanized after fabrication in accordance with Item 445.

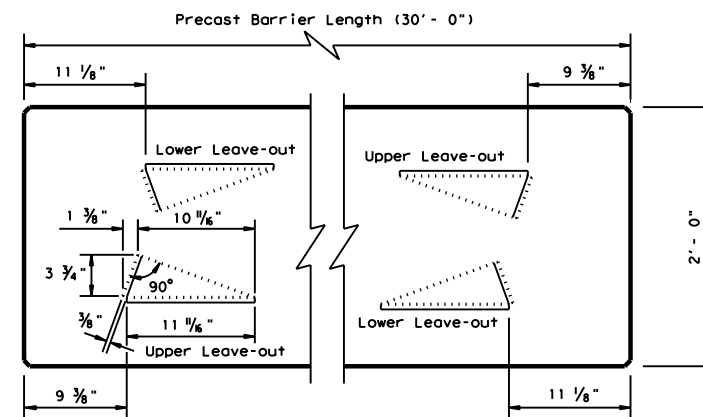


BARRIER PLAN AT END JOINTS

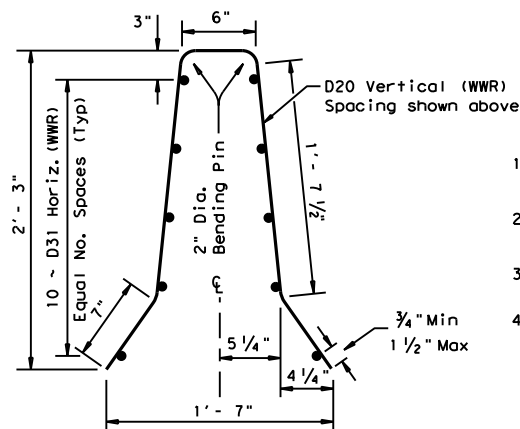

**Welded Wire Reinforcement
(WWR) Option for Bars R and S3**

(WWR) General Notes


- Deformed Welded Wire Reinforcement (WWR) shall conform to ASTM A497.
- Welded wire cage may be cut or bent to accommodate the Type X joint connection and drainage slots, as directed by the Engineer.
- All reinforcement shall comply with Item 440, "Reinforcing Steel."
- Combinations of reinforcing steel and WWR will be permitted, as directed by the Engineer. The dimension from the end of the barrier section to the first wire shall not exceed 3".

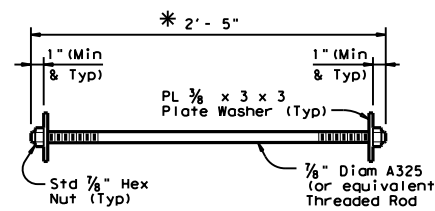

**CONNECTION BOLT OR
THREADED ROD DETAIL**

Two (2) Threaded Rods (or Equivalent Hex Hd. Bolts) (w/ Two (2) PL 3/8 x 3 x 3 Plate Washers & Two (2) Std Hex Nuts) required per joint.

* The connection hardware shall not extend beyond the concrete face of the barrier. Hex head bolts may be provided. The proper length of all hardware should be verified.

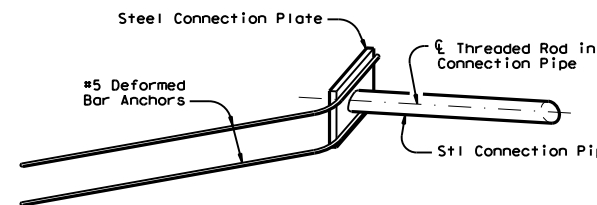

**ISOMETRIC OF
TYPICAL WELDED ASSEMBLY**


Four (4) [2 Upper & 2 Lower] Assemblies required per joint.

Weight of one Precast 30 ft. (CSB) segment = Approx. 6.5 Tons or 440 lbs per ft.


SHEET 1 OF 2

		Design Division Standard	
CONCRETE SAFETY BARRIER (F-SHAPE)			
PRECAST BARRIER (TYPE 1)			
CSB(1)-10			
FILE: csb110.dgn	DN: TxDOT	CK: AM	DW: BD
© TxDOT December 2010	CONT	SECT	JOB
REVISIONS			HIGHWAY
	DIST	COUNTY	SHEET NO.


DISCLAIMER: This standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

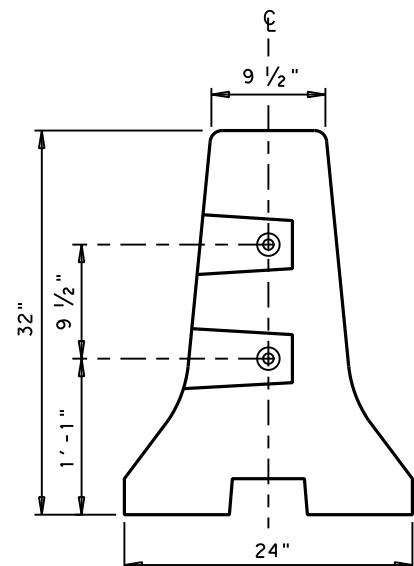

END VIEW (CSB) QUICK-BOLT
QUICK-BOLT POCKET LOCATIONS

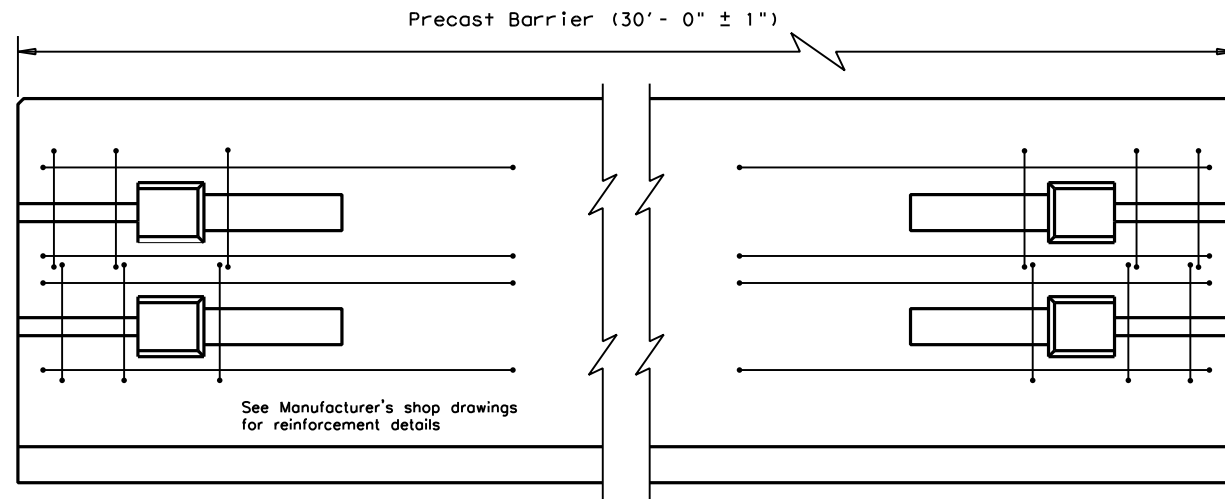


ELEVATION (CSB) QUICK-BOLT
See Manufacturer's shop drawing for additional details

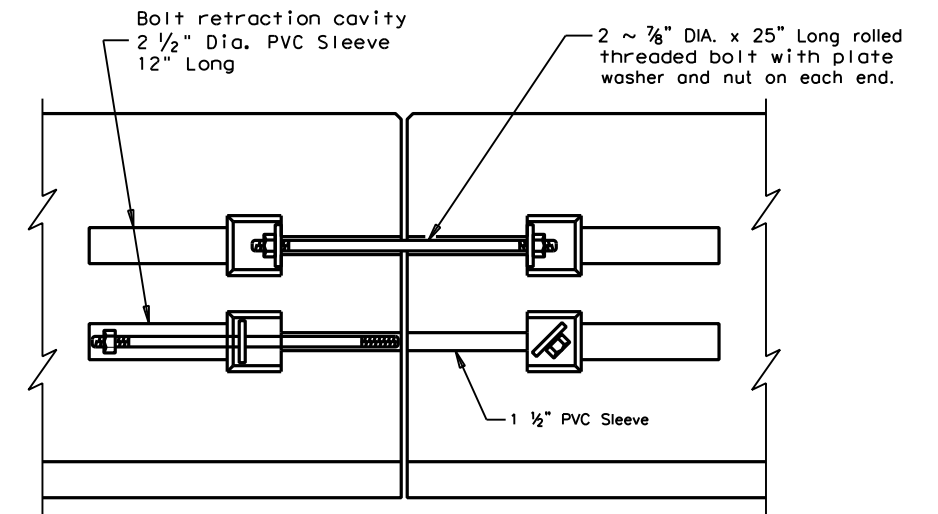


ELEVATION VIEW SHOWING JOINT CONNECTION
"QUICK-BOLT"

Joint Connection (Type Q)

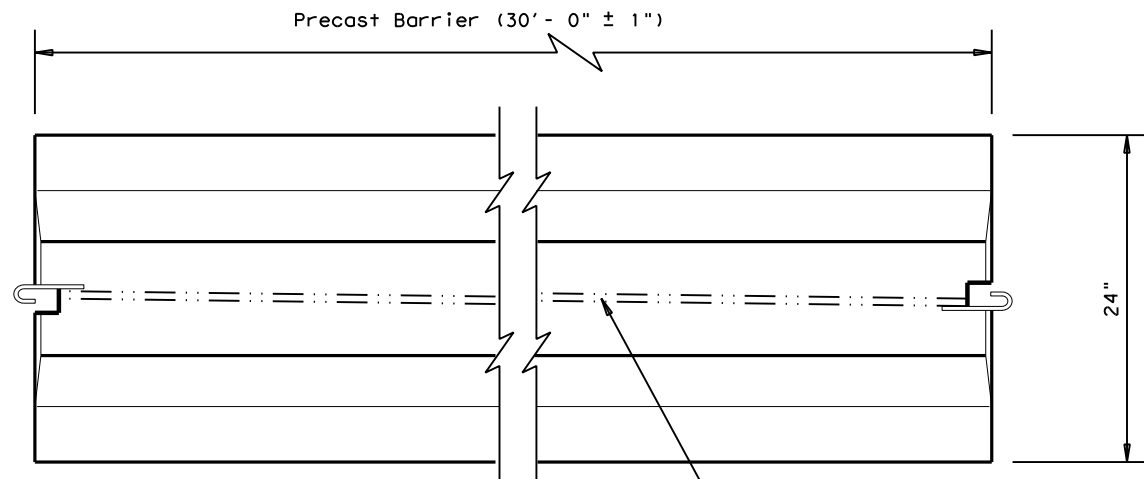


TOP VIEW
PRECAST (CSB) WITH J-J HOOKS
See Manufacturer's shop drawing for additional details

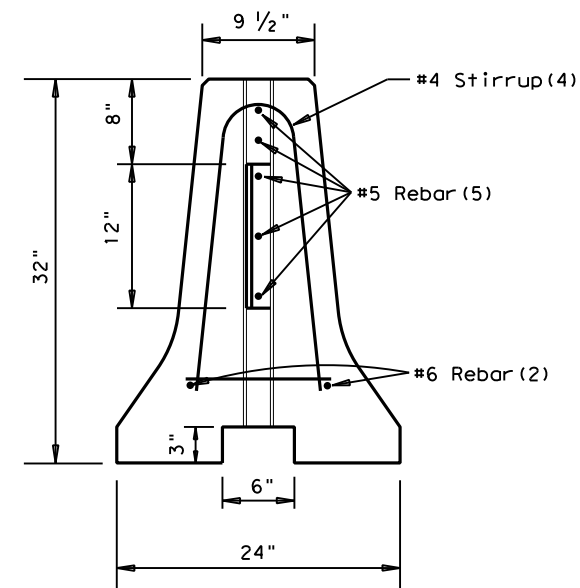

END VIEW
J-J HOOK CONNECTION

Joint Connection (Type J)

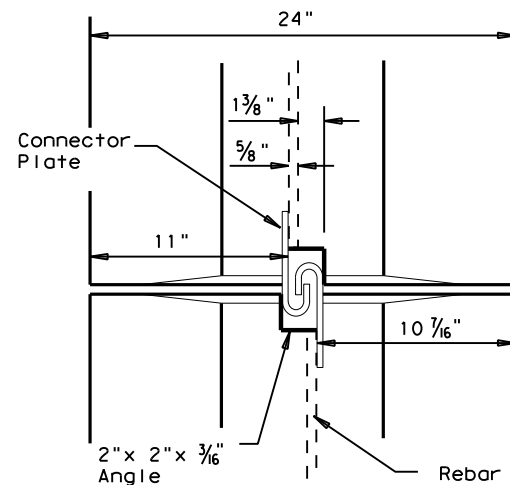

VIEW FROM ABOVE
J-J HOOK CONNECTION

Proprietary Joint Connections (CSB)

Two proprietary joint connections are acceptable as alternates to the (Type X) connection shown, here on. These joint connections types are:

J-J Hooks by Easi-Set Industries, (800)547-4045
Quick-Bolt by Bexar Concrete, (210)497-3773

If one of these connection systems are exclusively specified in the plans, prior approval for sole source use must be obtained. Details of the connection components and barrier reinforcement for these systems, will be shown on the manufacturer's shop drawing(s) furnished to the Engineer.

SHEET 2 OF 2

		Design Division Standard	
CONCRETE SAFETY BARRIER (F-SHAPE) PRECAST BARRIER (TYPE 1) CSB(1)-10			
FILE: csb110.dgn	DN: TxDOT	CK: AM	DW: BD
© TxDOT December 2010	CONT	SECT	JOB
REVISIONS		HIGHWAY	
DIST		COUNTY	
		SHEET NO.	

DATE:
FILE: