




DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

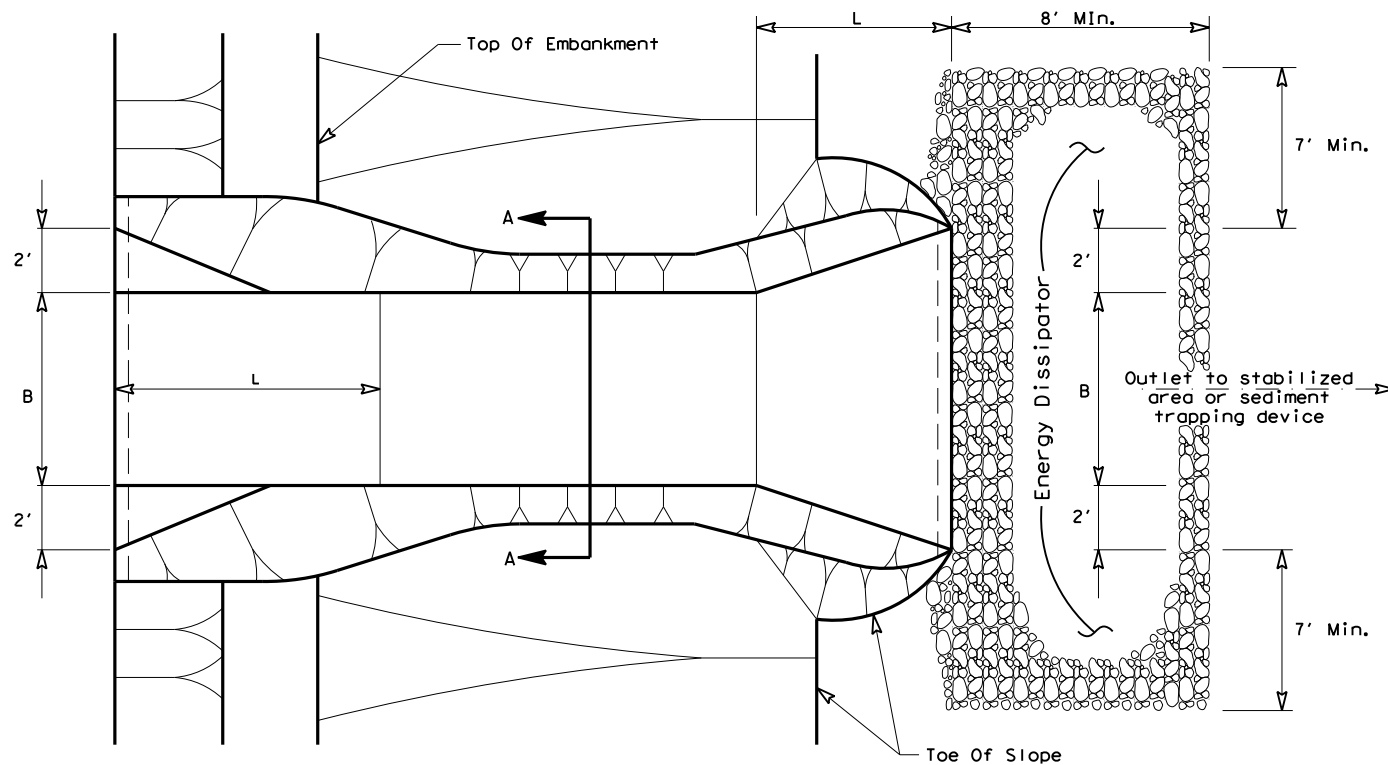

PLAN VIEW

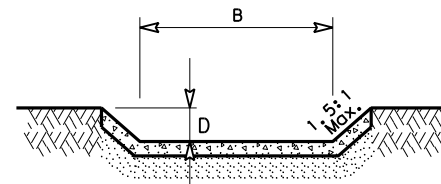

SECTION A-A

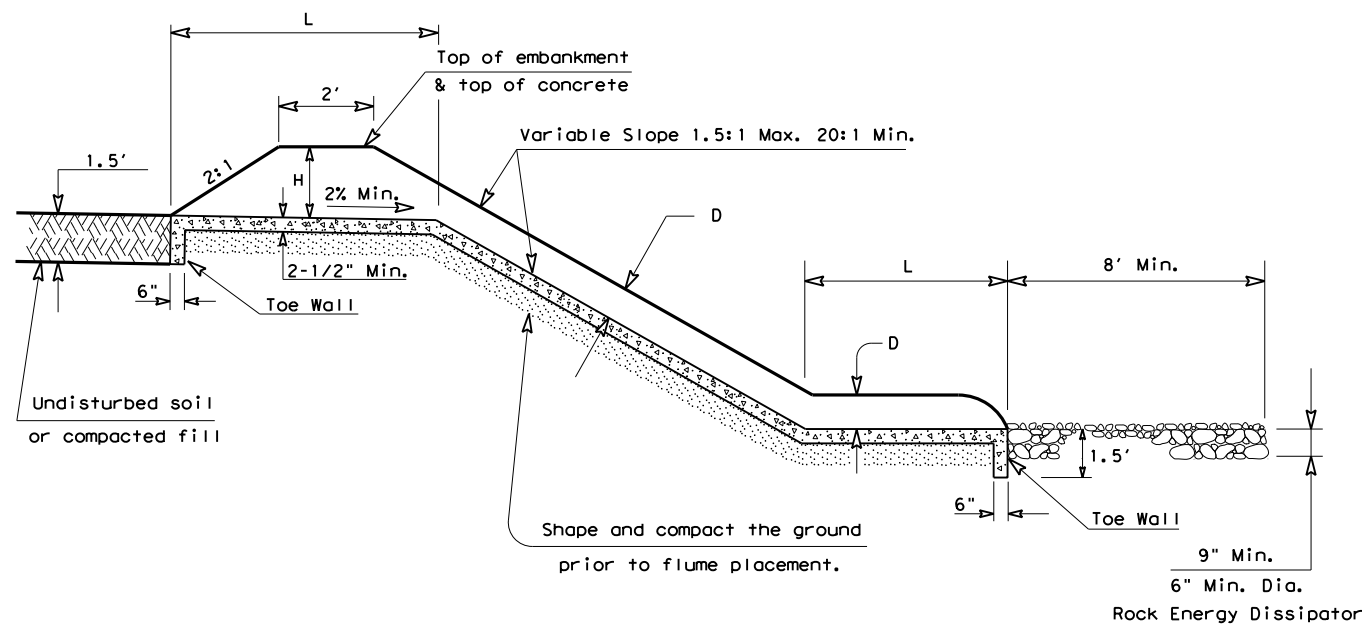

ELEVATION VIEW

PAVED FLUME



GENERAL NOTES

1. The group / size is a designator for the dimensions of the paved flume. The group / size is designated by a letter (A or B) and the bottom (B) dimension. The appropriate size shall be indicated on the construction plans.
2. Provide rock or rubble with a minimum diameter of 6" and a maximum volume of 1/2 cubic feet for construction of energy dissipaters.
3. For high velocity flows, the aggregate of the energy dissipator should be secured with 20-gauge galvanized woven wire mesh with 1" diameter hexagonal openings. The aggregate should be placed on the mesh to the dimensions specified. The mesh shall be folded at the upstream side over the aggregate and tightly secured to itself on the downstream side using wire ties or hog rings.
4. The guidelines shown hereon are suggestions only and may be modified by the Engineer.

PAVED FLUME USAGE GUIDELINES

A Paved Flume should be constructed to drain concentrated surface runoff safely down slopes without causing erosion. The drainage area contributing runoff to a paved flume should not exceed that given in the Design Criteria above. The paved flume should be sized to drain the peak rate of runoff without overtopping the embankment at the earth dike entrance. A 25 year storm frequency may be used to calculate the flow rate.

DESIGN CRITERIA

Group/Size	B Bottom Width	H Min.	D Min.	L Min.	Maximum Drainage Area
A-2	2'	1.5'	8"	5'	5 Acres
A-4	4'	1.5'	8"	5'	8 Acres
A-6	6'	1.5'	8"	5'	11 Acres
A-8	8'	1.5'	8"	5'	14 Acres
A-10	10'	1.5'	8"	5'	18 Acres
B-4	4'	2'	10"	6'	14 Acres
B-6	6'	2'	10"	6'	20 Acres
B-8	8'	2'	10"	6'	25 Acres
B-10	10'	2'	10"	6'	31 Acres
B-12	12'	2'	10"	6'	36 Acres

PLANS SHEET LEGEND

Paved Flume

Design Division Standard

TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES

TEMPORARY PAVED FLUMES

EC (8) - 16

FILE: ec816	DN: TxDOT	CK: KM	DW: VP	DN/CK: LS
© TxDOT: JULY 2016	CONT	SECT	JOB	HIGHWAY
REVISIONS				
DIST	COUNTY			SHEET NO.

DATE:
FILE: